



NOTE:
 AT BUILDING EDGES WHERE VERTICAL WALL DOES NOT RECEIVE ROOFING MATERIALS, THE 3" TURNED DOWN REINFORCED MEMBRANE IS FULLY ADHERED DIRECTLY TO THE BUILDING FACADE.

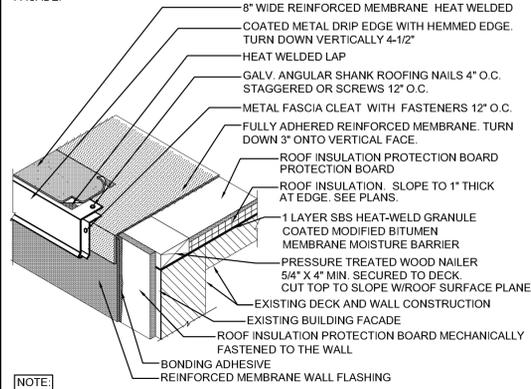

NOTE:
 1. REFER TO DETAIL ROOFING MANUFACTURER'S SPECIFICATIONS FOR METAL JOINT DETAIL.
 2. A CONTINUOUS METAL CLEAT IS REQUIRED.
 3. APPLY TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES.

1 DETAIL AT DRIP EDGE WITH COATED METAL EDGE


A501 NTS 200-300 211A

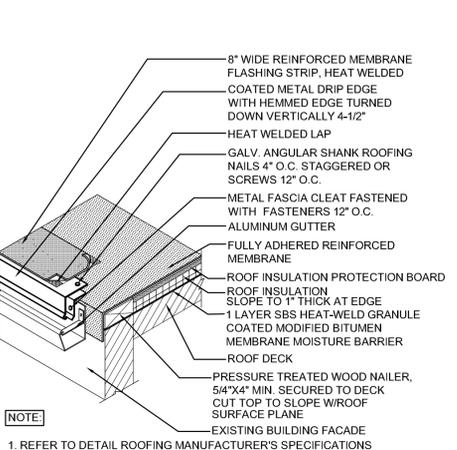

NOTE:
 1. REFER TO DETAIL ROOFING MANUFACTURER'S SPECIFICATIONS FOR METAL JOINT DETAIL.
 2. A CONTINUOUS METAL CLEAT IS REQUIRED.
 3. APPLY TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES.

2 DETAIL AT GUTTER WITH COATED METAL EDGE


A501 NTS 200-300 211

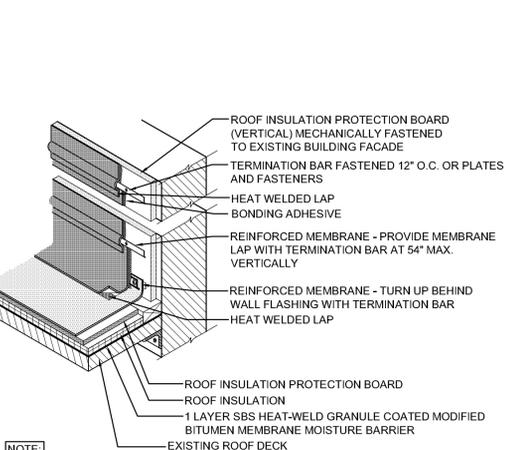

NOTE:
 1. APPLY TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES

3 DETAIL AT HIGH WALL FLASHING


A501 NTS 200-300 306

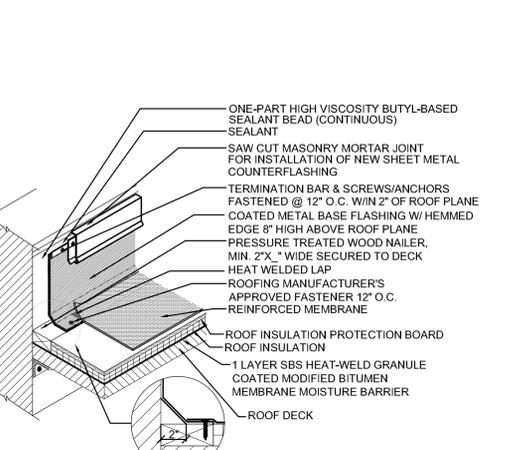

NOTE:
 1. APPLY TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES

4 DETAIL AT COATED METAL WALL FLASHING


A501 NTS 200-300 308

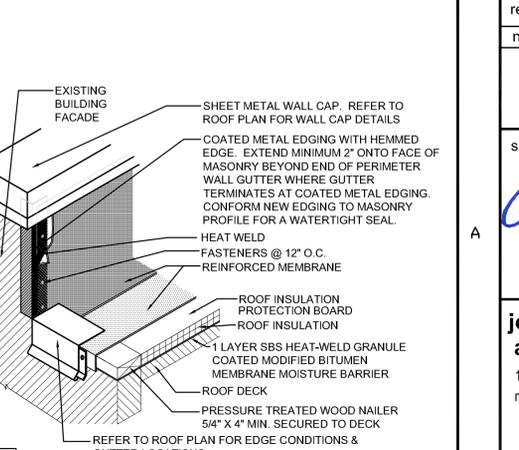

NOTE:
 1. REFER TO ROOF PLAN AND ACTUAL FIELD CONDITIONS FOR SPECIFIC EDGE DETAIL FOR APPLICATION.
 2. APPLY TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES

5 TYP. PARAPET END WALL VERTICAL MEMBRANE WALL FLASHING DETAIL

A501 NTS 200-300 314




6 NOT USED

A501 NTS



7 NOT USED


A501 NTS

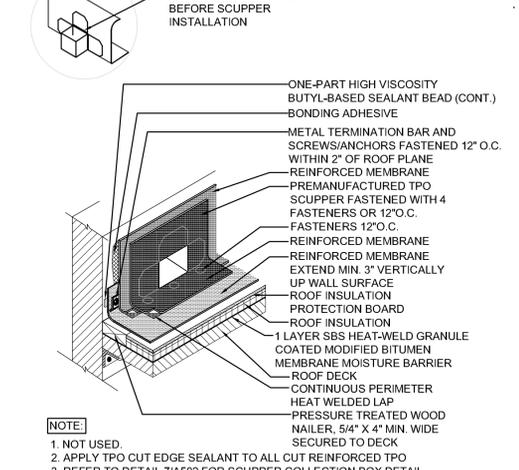

NOTE:
 1. NOT USED.
 2. APPLY TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO
 3. REFER TO DETAIL 7/A502 FOR SCUPPER COLLECTION BOX DETAIL


8 DETAIL AT SCUPPER

A501 200-300 324

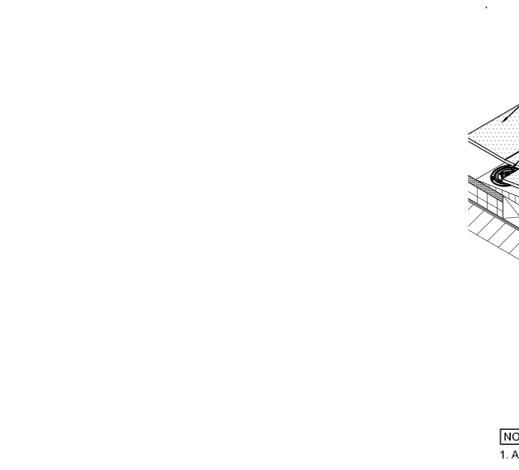


9 NOT USED

A501 NTS

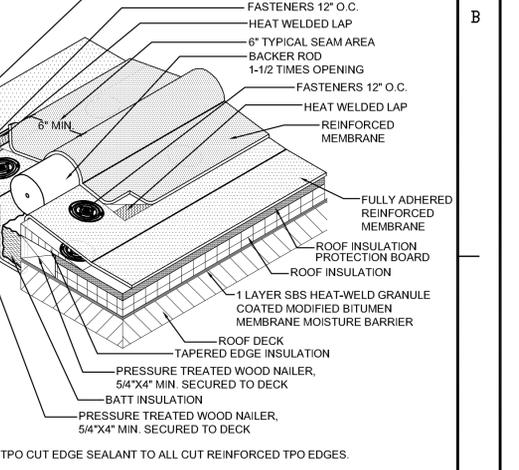


10 TYPICAL ROOF EXPANSION JOINT DETAIL

A501 NTS

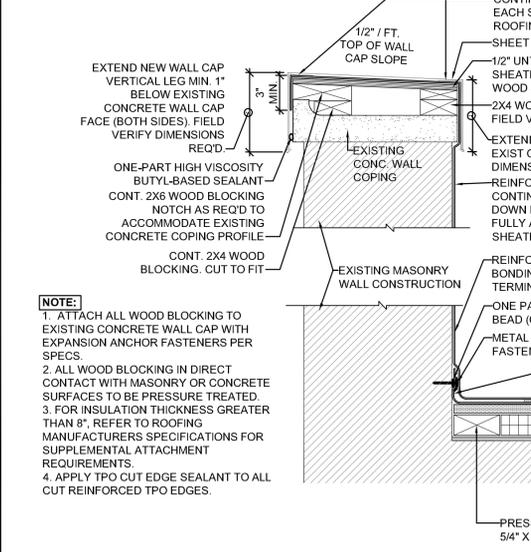


11 DETAIL AT NEW WALL CAP CONSTRUCTION WITH TYPICAL PARAPET WALL BASE TERMINATION

A501 NTS 400-600 501

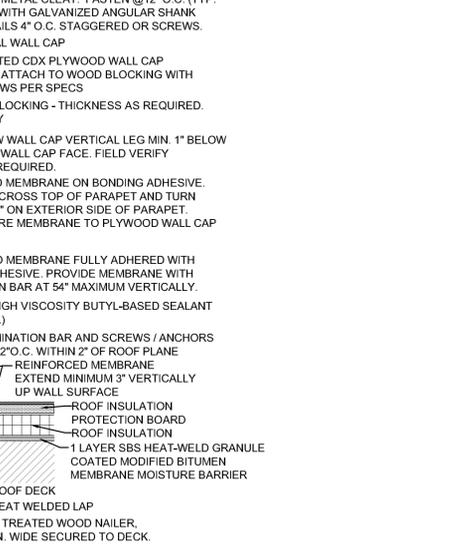


12 NOT USED

A501

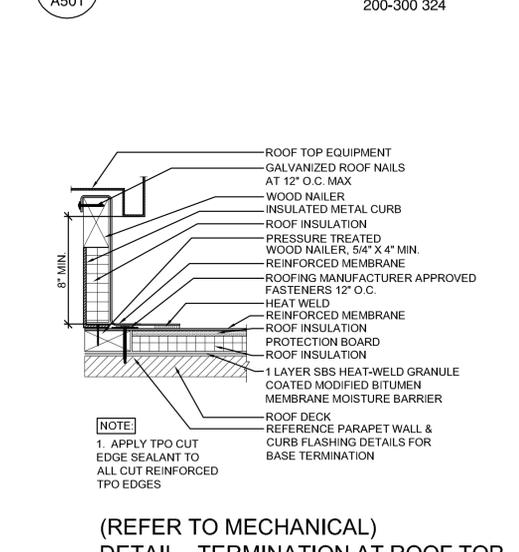


13 (REFER TO MECHANICAL) DETAIL - TERMINATION AT ROOF TOP EQUIPMENT CURB REPLACEMENT WITH WELDED LAP

A501

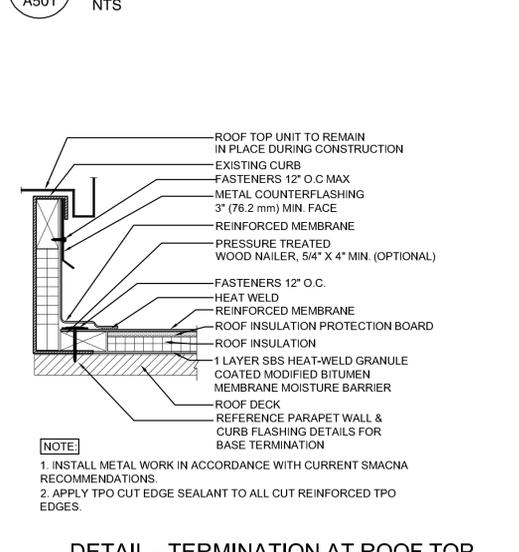

14 DETAIL - TERMINATION AT ROOF TOP EQUIPMENT TO REMAIN IN PLACE WITH COUNTERFLASHING

A501 NTS

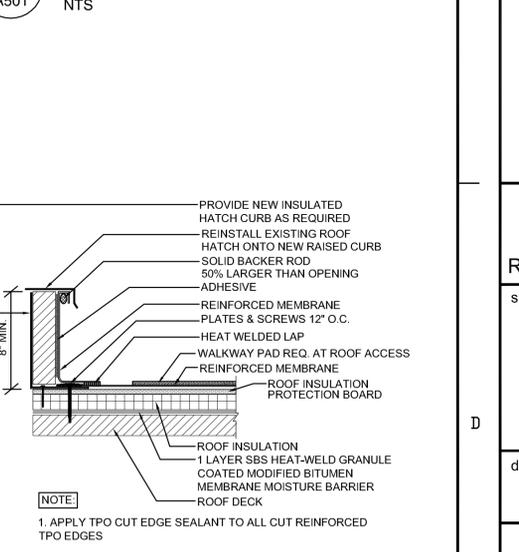

15 DETAIL AT ROOF HATCH

A501 NTS 400-600 505

revisions

no.	date

seal

john pruetts architects
 1869 madison ave.
 memphis, tn 38104
 (901) 721-9062

pruettsarchitects@bellsouth.net
 www.pruettsarchitects.com

ROOF REPLACEMENT
Peggy Edmiston Administration Building
 1075 Mullins Station Road, Memphis, TN 38134

BID DOCUMENT SET
 RFP # 14-011-24-A

sheet name
DETAILS

date
11.18.2013

A-501