
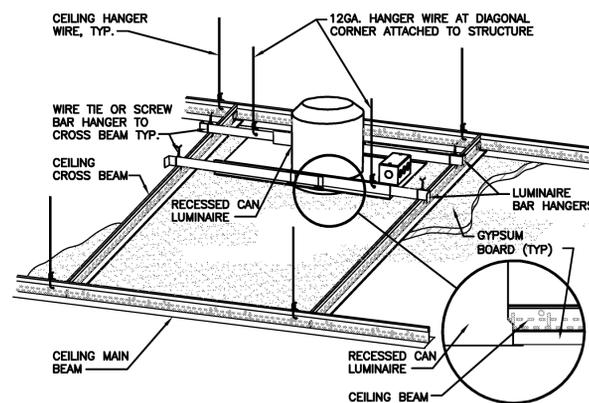
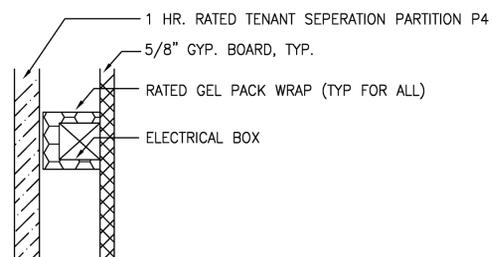


REFERENCE NOTES:


- PANEL "TCP" IS LOCATED IN CONTROL TOWER. SEE SHEET E1.2. COORDINATE WITH FIRING RANGE CONSULTANT DRAWINGS FOR EXACT LOCATION AND PANEL REQUIREMENTS.
- CONTRACTOR SHALL PROVIDE PIGTAILS AND WEATHERHEAD ON POWER POLE FOR CONNECTION TO MLGW SERVICE CONDUCTORS. CONTRACTOR SHALL ROUTE SERVICE ENTRANCE CONDUCTORS FROM WEATHERHEAD DOWN POLE AND UNDERGROUND TO WIRING TROUGH. CONDUIT EXPOSED TO THE ELEMENTS SHALL BE IMC. CONDUIT ROUTED UNDERGROUND SHALL BE PVC.

FEEDER SCHEDULE (SHEET E0.2):


- 4 || SETS OF 4-250 MCM ALUMINUM - 2 1/2" C (EACH)
- 2 || SETS OF 4-250 MCM ALUMINUM, #4/O ALUMINUM GND - 2 1/2" C (EACH)
- 4-250 MCM ALUMINUM, #1/O ALUMINUM GND - 2 1/2" C
- 4-#2 ALUMINUM, #6 ALUMINUM GND - 1 1/2" C
- 3 || SETS OF 4-250 MCM ALUMINUM, #4/O ALUMINUM GND - 2 1/2" C (EACH)

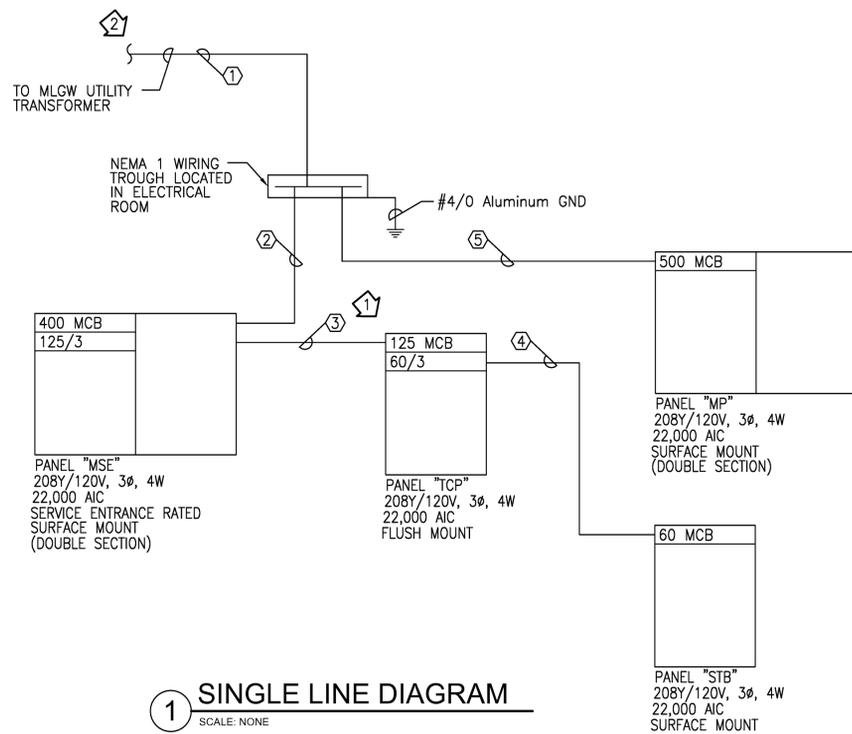


3 DOWNLIGHT MOUNTING - GYPBOARD CEILING
SCALE: NONE

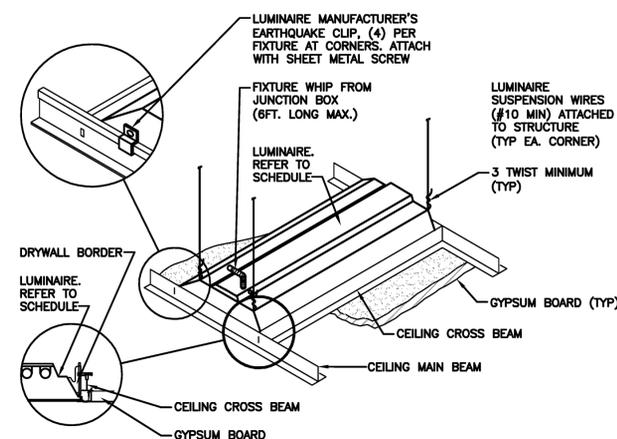

5 LUMINAIRE MOUNTING - GYPBOARD CEILING
SCALE: NONE

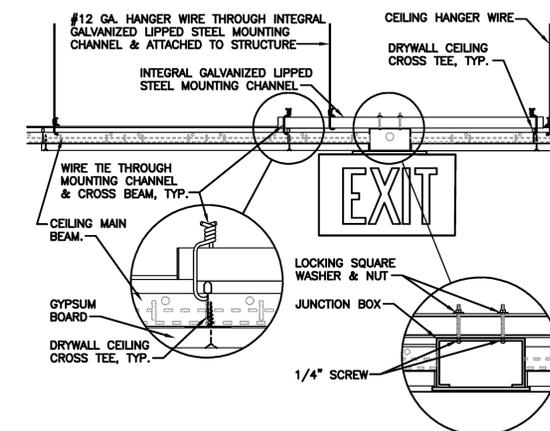

4 EXIT SIGN MOUNTING - GYPBOARD CEILING
SCALE: NONE

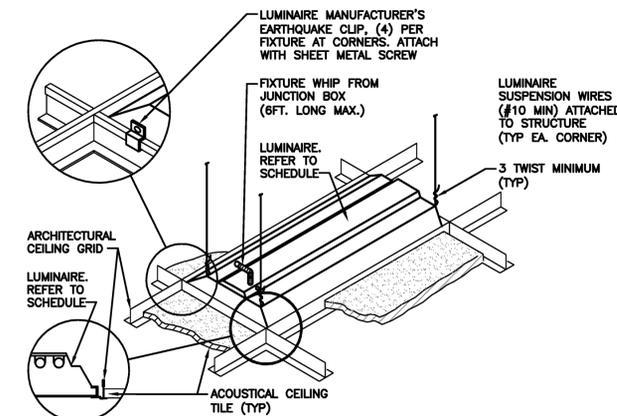

6 LUMINAIRE MOUNTING - LAY-IN CEILING
SCALE: NONE



REVISIONS:

DATE: AUGUST 28, 2012
 DRAWN BY: KES
 SHEET TITLE: SINGLE LINE DIAGRAM & DETAILS - ELECTRICAL
 SHEET NO:

E0.2