



NOTE
 1. INSTALL METAL WORK IN ACCORDANCE WITH CURRENT SMACNA RECOMMENDATIONS.
 2. APPLY TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES.

RTU CURBS TO REMAIN DETAIL
 NOT TO SCALE

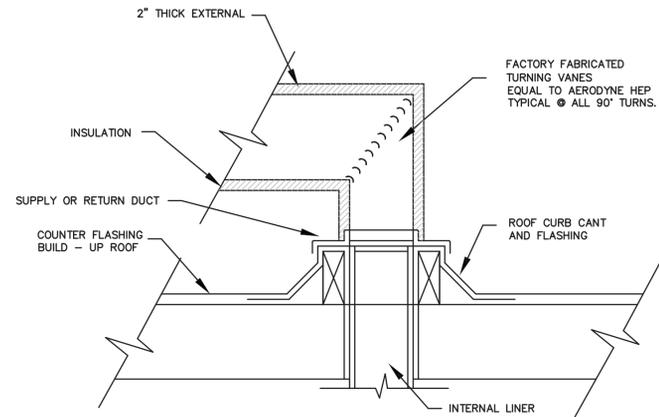


DUCT PENETRATION DETAIL AT ROOF
 NOT TO SCALE

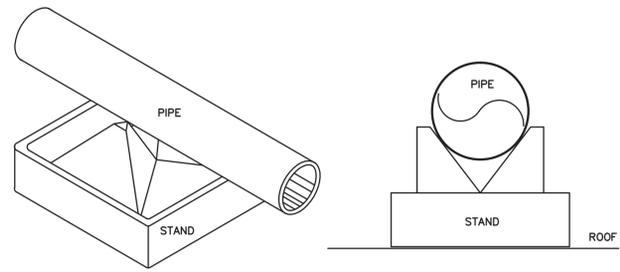


PIPE STAND EQUAL TO MIRO INDUSTRIES MIRO MODEL 1.5 TO BE PLACED EVERY 10' AND AT EACH TURN.

PILLOW BLOCK WATER PIPE STAND DETAIL
 NOT TO SCALE

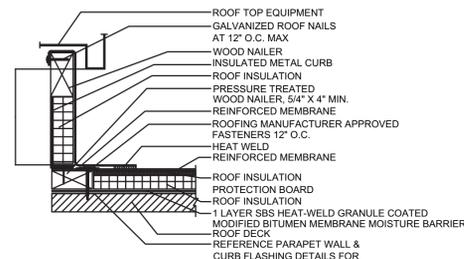

NOTE
 1. APPLY TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES


RTU CURBS TO BE REPLACED
 NOT TO SCALE

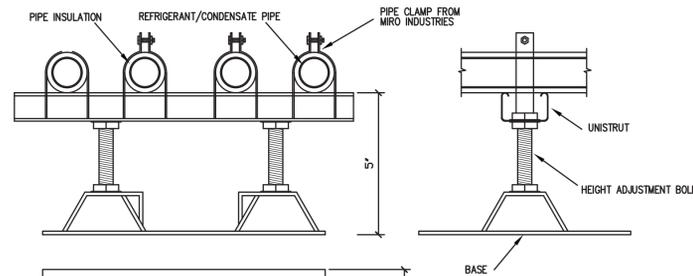

NOTE: NOT TO EXCEED 10 FOOT CENTER AND MAX. WEIGHT 100 POUNDS


MIRO 2.5 - CONDUIT SUPPORT-5,7, OR 12 FOR CONDENSATE & ELECTRICAL CONDUIT
 NOT TO SCALE

1. FOR CONDUIT AND CONDENSATE PIPE SUPPORT USE MIRO# 2.5 CONDUIT SUPPORT-5,7 OR 12 DEPENDING UPON PIPE HEIGHT- INCLUDING SUPPORT PAD
 2. FOR GAS PIPE SUPPORT USE MIRO# 3-RAH-7, 12, OR 4-RAH-7, 12 INCLUDING SUPPORT PAD.

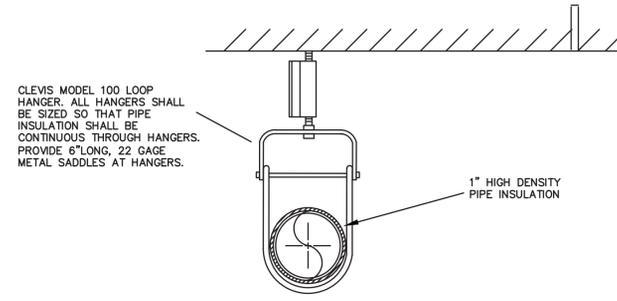


CLEVIS MODEL 100 LOOP HANGER. ALL HANGERS SHALL BE SIZED SO THAT PIPE INSULATION SHALL BE CONTINUOUS THROUGH HANGERS. PROVIDE 6\"/>

HANGER DETAIL FOR CONDENSATE PIPE INSIDE BUILDING
 NOT TO SCALE

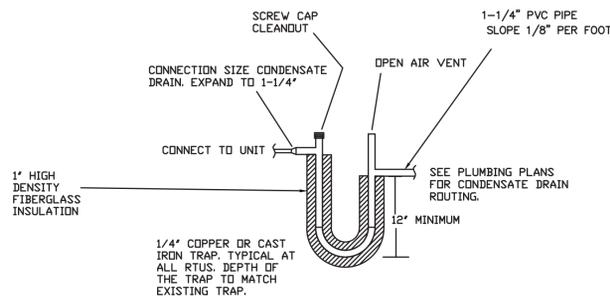

P-TRAP DETAIL
 NOT TO SCALE

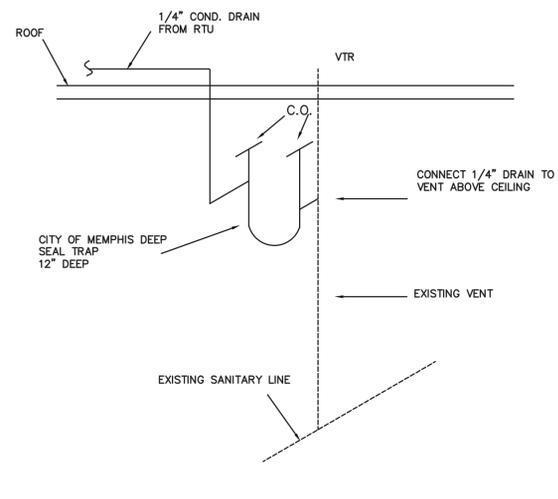

DEEP SEAL TRAP DETAIL
 NOT TO SCALE

DETAILS
 NO SCALE

revisions	
no.	date

john pruet
architects
 1869 madison ave.
 memphis, tn 38104
 (901) 721-9062

pruetarchitects@bellsouth.net
 www.pruetarchitects.com

ROOF REPLACEMENT
Peggy Edmiston Administration Building
 1075 Mullins Station Road, Memphis, TN 38134

BID DOCUMENT SET
RFP # 14-011-24-A

sheet name
M-2

date
11.18.2013