WARNING
Reset
SILENT KNIGHT

ALARM
TROUBLE
SUPERVISORY
SILENCED
AC
RESET
SILENCE
ACK
ENTER
K5208

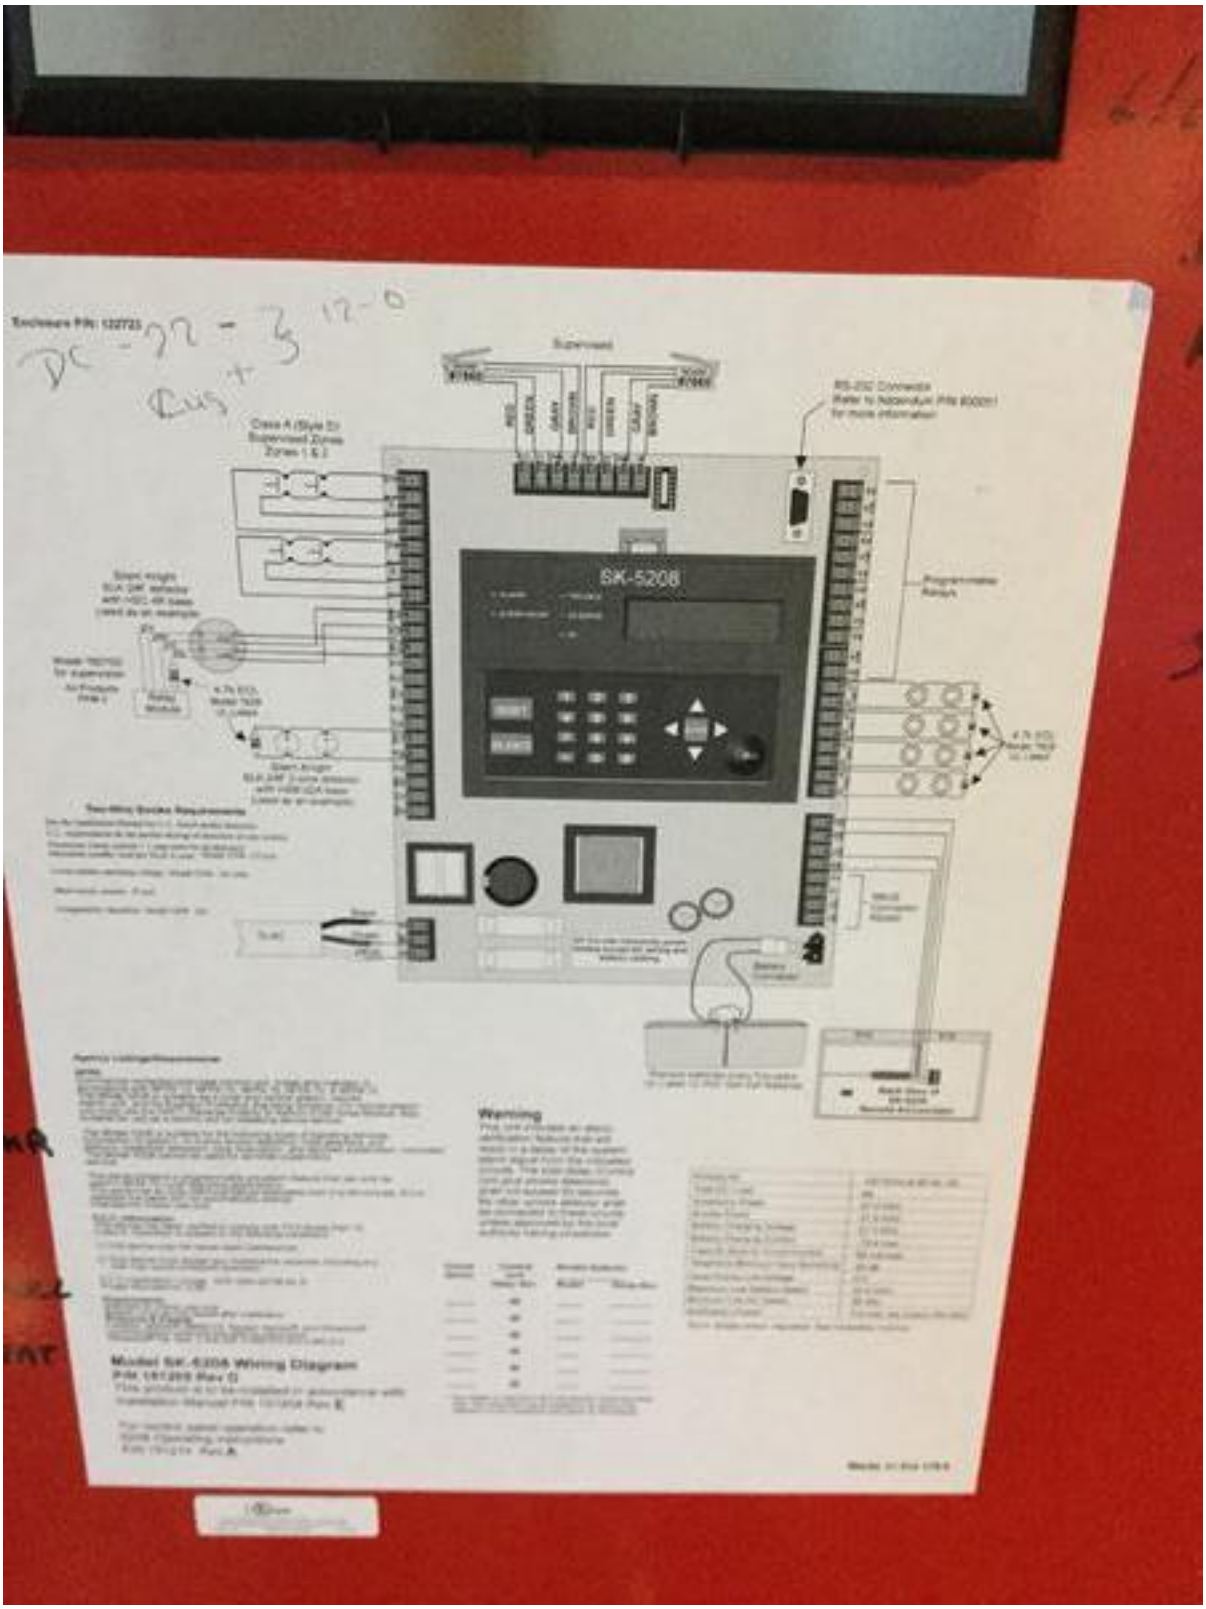
Enclosure P/N: 122723
Supervised
Class A (Style D)
Supervised Zones
Zones 1 & 2
SK-5208
Warning
Model SK-5208 Wiring Diagram

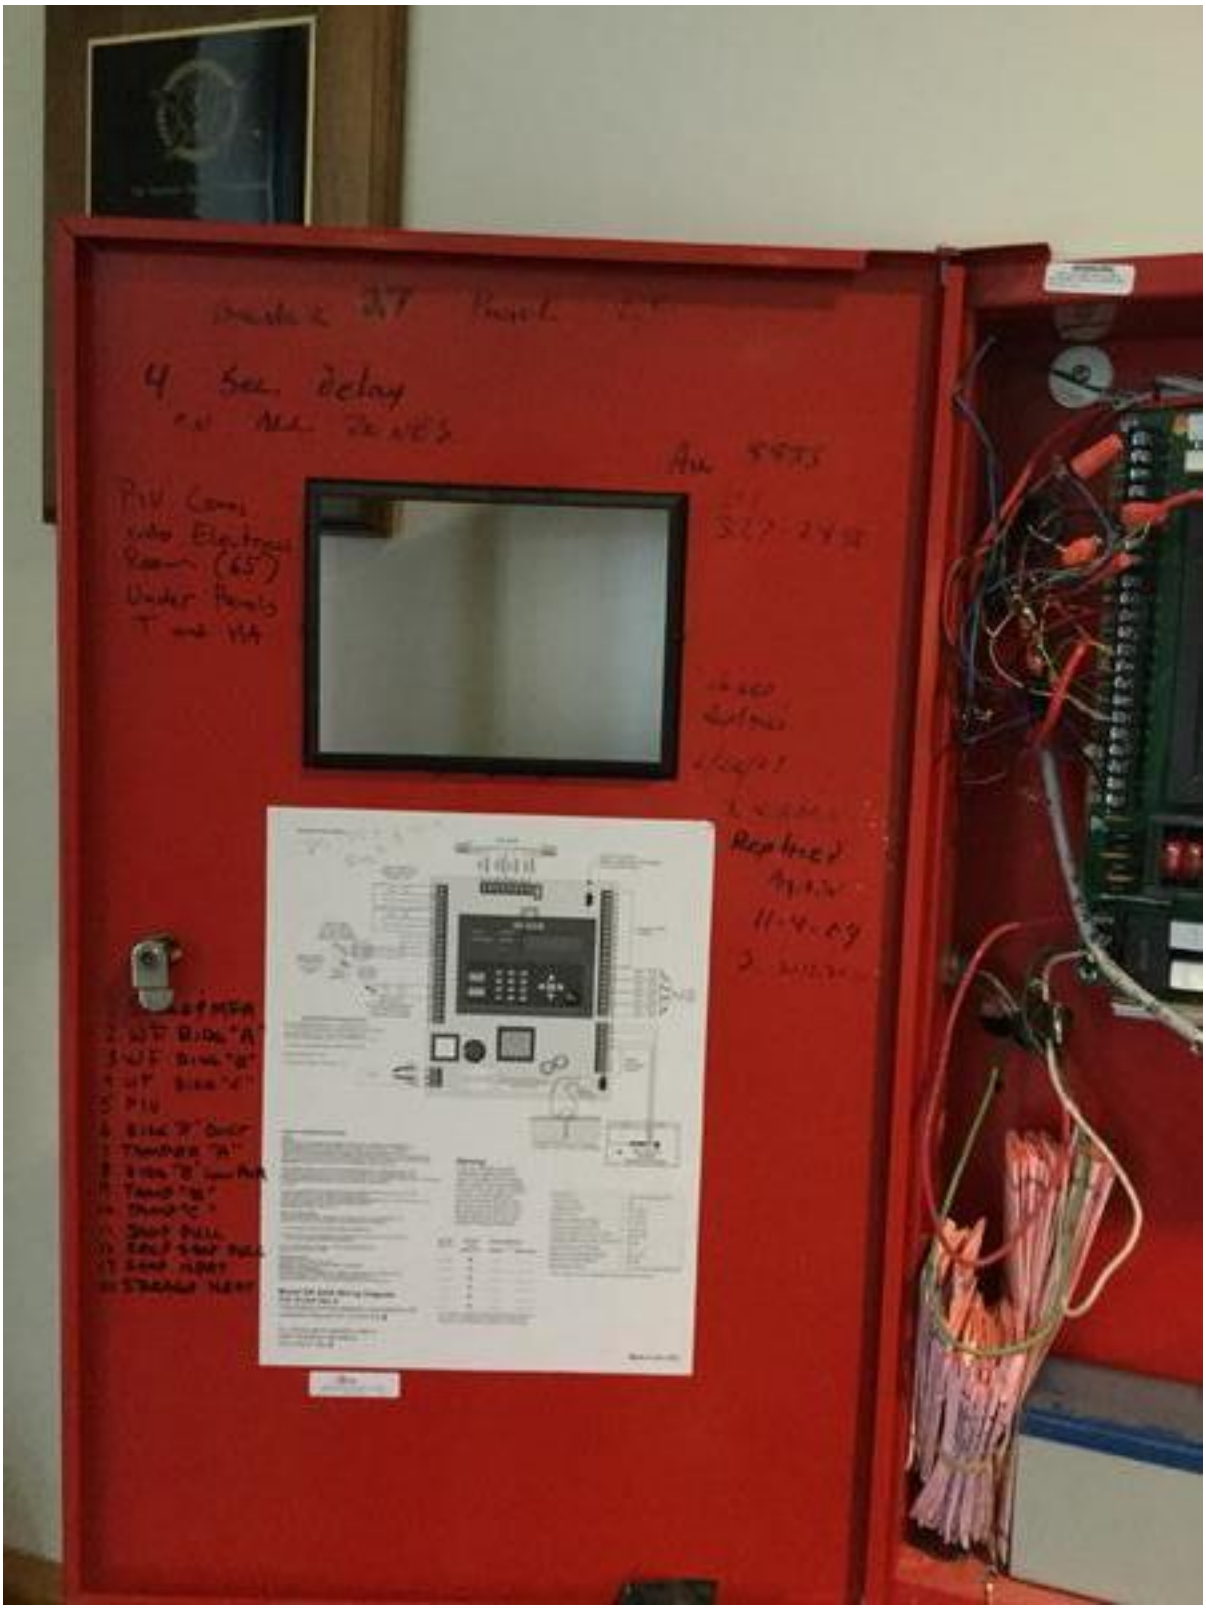
4 Sec. delay
Replaced
11-4-09

VK102 VK104