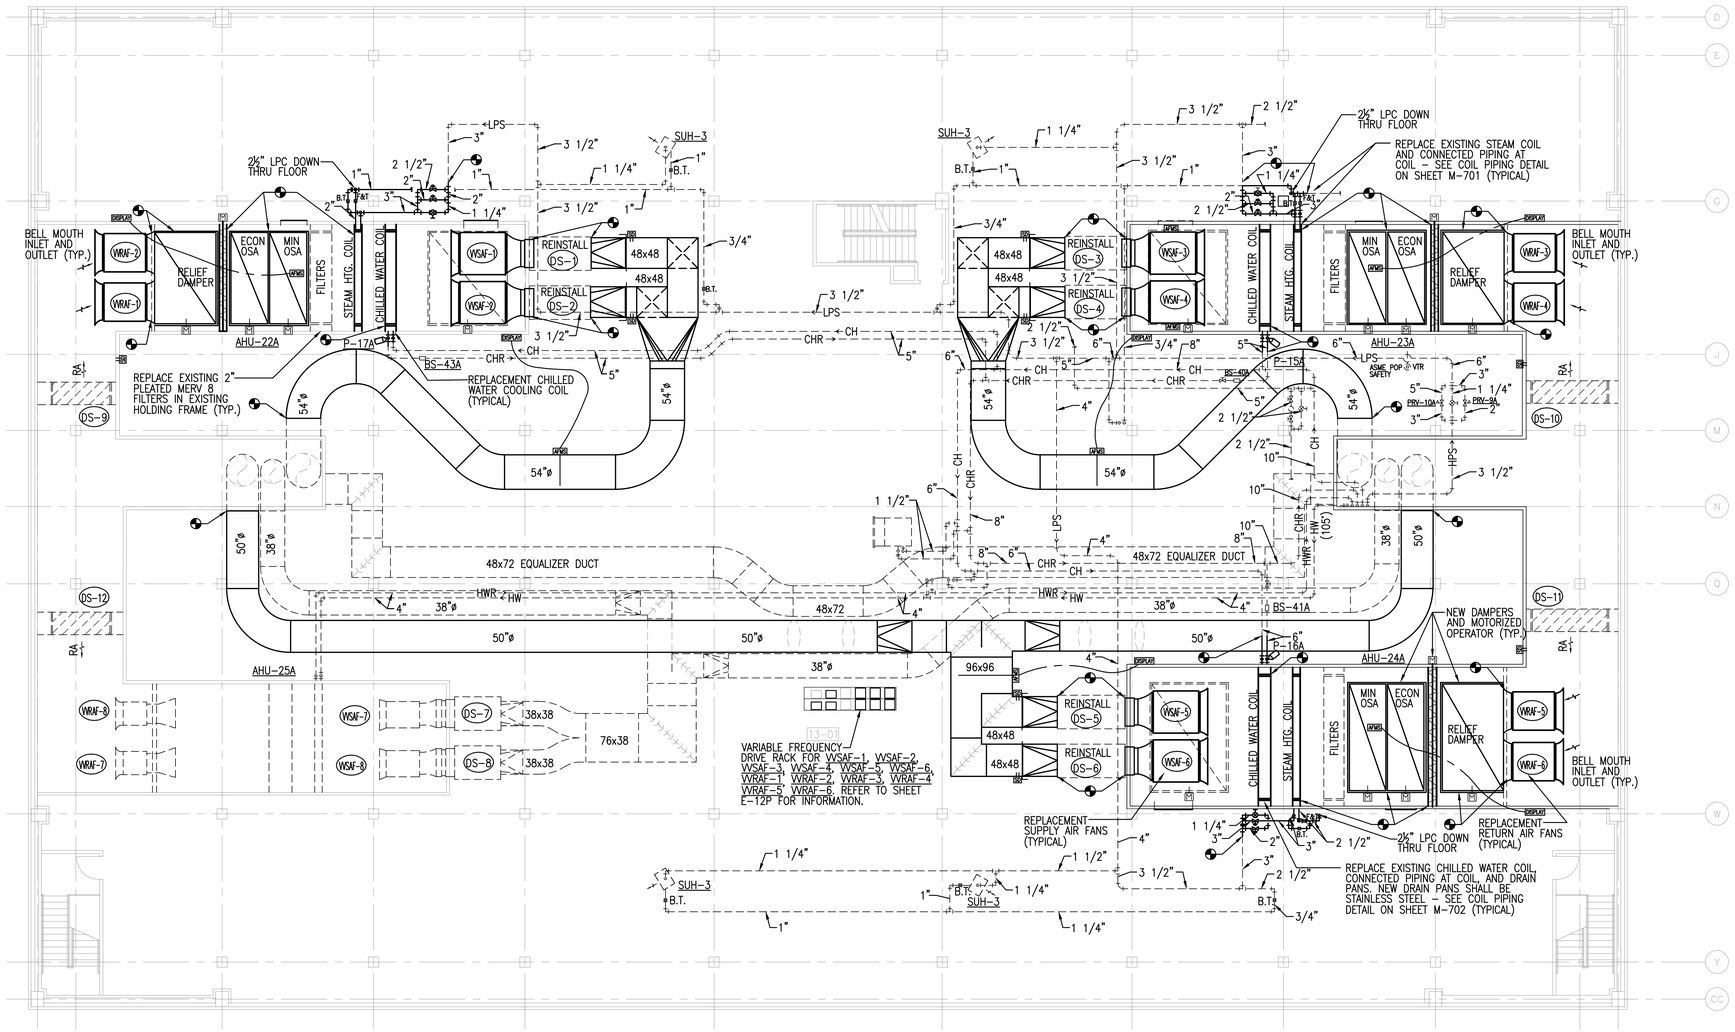

1 THIRTEENTH FLOOR PLAN - HVAC RENOVATION
SCALE: 1/8" = 1'-0"

0' 2' 4' 8' 16'

NORTH

RENOVATION NOTES FOR BUILT-UP AHUS

1. MODIFY AHU CASING AS REQUIRED FOR OTHER AHU MODIFICATIONS IN THIS PROJECT. AFTER MODIFICATIONS ARE COMPLETE, AHU CASING AND INSULATION SHALL BE PLACED BACK IN ORIGINAL CONDITION.
2. CLEAN ENTIRE INTERIOR OF AHU.
3. PROVIDE SUPPORT FRAMES FOR INLINE SUPPLY AND RETURN FANS SIMILAR TO EXISTING FAN SUPPORT FRAMES.
4. MODIFY OR REPLACE EXISTING BLANKOFF PLATES AT PERIMETER OF NEW COOLING COILS. SHEET METAL GAUGE SHALL MATCH EXISTING. SEAL SO THAT ALL AIR GOES THRU FACE OF COOLING COIL.
5. REPLACE EXISTING MARINE LIGHTS, FILTER DIFFERENTIAL PRESSURE SENSOR, AND FREEZESTAT FOR CHILLED WATER COIL.
6. CONTRACTOR IS RESPONSIBLE FOR EQUIPMENT AND COIL ENTRY INTO THE BUILDING. ANY WALLS, DOORS, OR WINDOWS THAT ARE REMOVED FOR COMPONENT EGRESS INTO THE BUILDING SHALL BE REPAIRED TO EXISTING CONDITIONS.
7. REFER TO SHEET M-803 FOR CONTROL DAMPER TYPES AND ADDITIONAL INFORMATION.

REVISIONS:

1		
2		
3		
4		
5		

PROJECT #: 24308.00
DATE: APRIL 10, 2015
DRAWN BY: EJK
DESIGNER: JRF
CHECKED BY: MRB

Pickering
Pickering Firm, Inc.
Facility Design • Civil Engineering • Surveying • Transportation • Natural Water Resources
6775 Lenox Center Court, Suite 300
Memphis, TN 38115
901.726.0810

OGCB Incorporated
3405 Poplar Avenue, Suite 200
Memphis, TN 38111/901-452-6283
Mechanical/Electrical Consulting Engineers

SBI-000320
HVAC RETROFIT PHASE II
SHELBY COUNTY CRIMINAL JUSTICE CENTER
201 POPLAR AVENUE
MEMPHIS, TENNESSEE 38103

SEAL:



SHEET NUMBER:

M-13P

DESCRIPTION:
THIRTEENTH FLOOR PLAN-HVAC RENOVATION

4/9/2015 1:12:27 AM MRE 62A2R