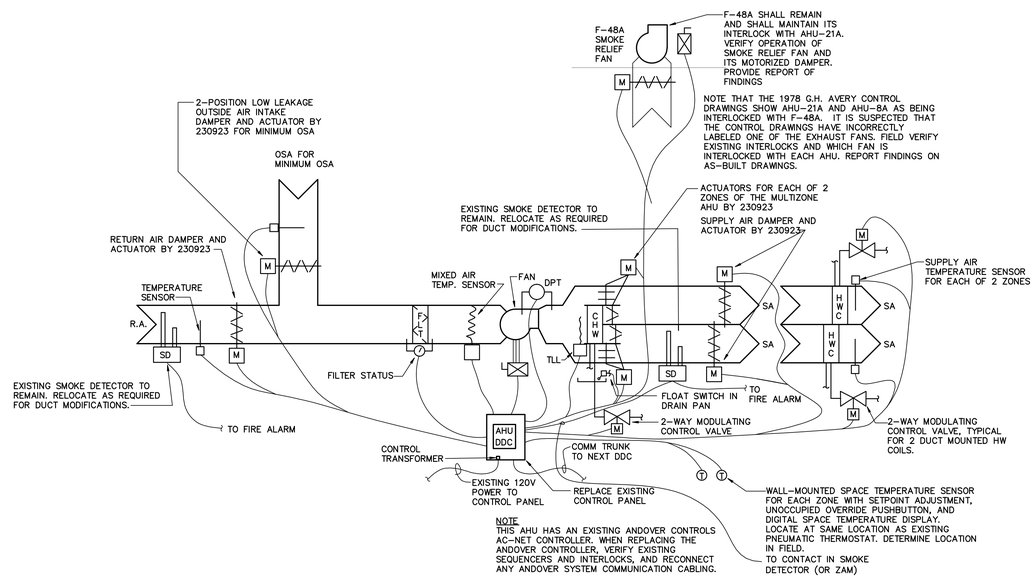

CONSTANT VOLUME MULTIZONE AIR HANDLING UNITS AHU-21A

APPROXIMATE DUCT MOUNTED DAMPER SIZES FROM 1978 CONTROL DRAWINGS (FIELD VERIFY)
AHU-21A: 12x12 OSA, 42x28 RA, 1@20x16 RA, 1@ 16x14 RA

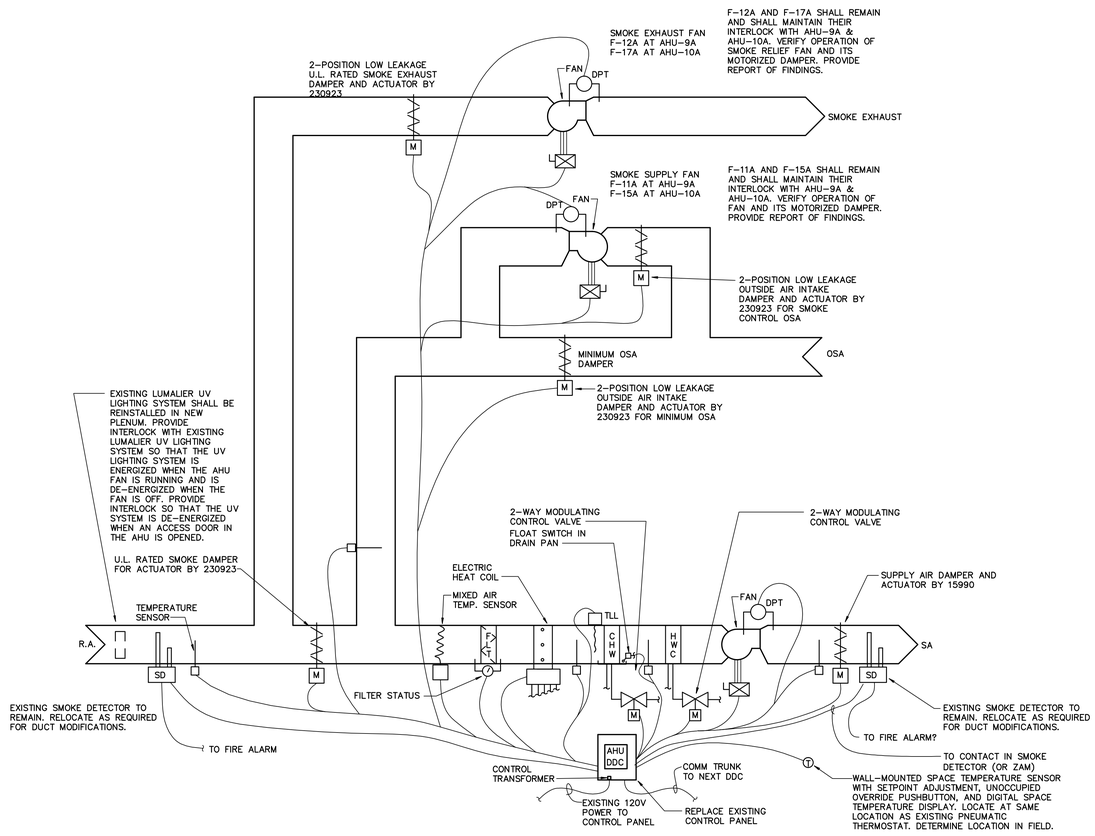

CONSTANT VOLUME AIR HANDLING UNITS AHU-9A AND 10A

APPROXIMATE DUCT MOUNTED DAMPER SIZES FROM 1978 CONTROL DRAWINGS (FIELD VERIFY)
AHU-9A: 24x24 RA, 20x20 OSA, 20x20 EXH, 20x20 SMOKE SUPPLY, 36x16 SA
AHU-10A: 24x24 RA, 18x18 OSA, 18x18 EXH, 18x18 SMOKE SUPPLY, 36x14 SA

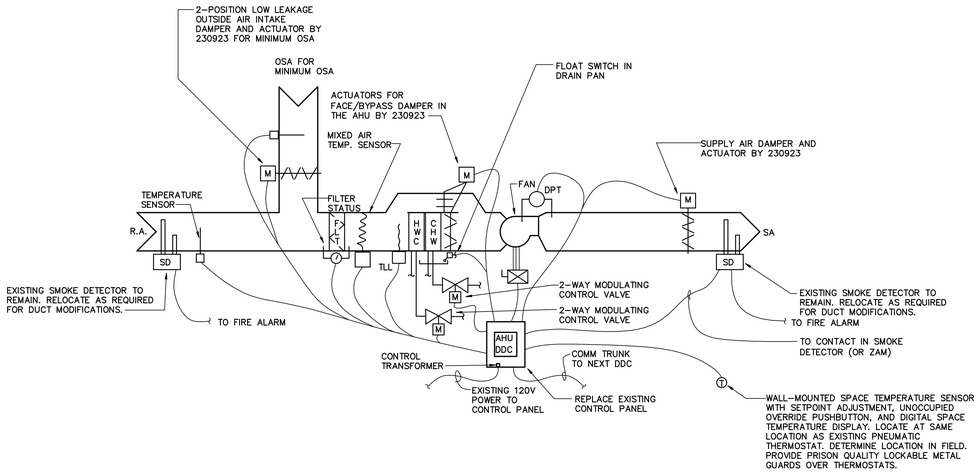

CONSTANT VOLUME AIR HANDLING UNITS AHU-1B AND 2B

APPROXIMATE DUCT MOUNTED DAMPER SIZES FROM 1978 CONTROL DRAWINGS (FIELD VERIFY)
AHU-1B: 12x10 OSA, 22x22 SA, AHU-2B: 12x10 OSA, 22x22 SA,

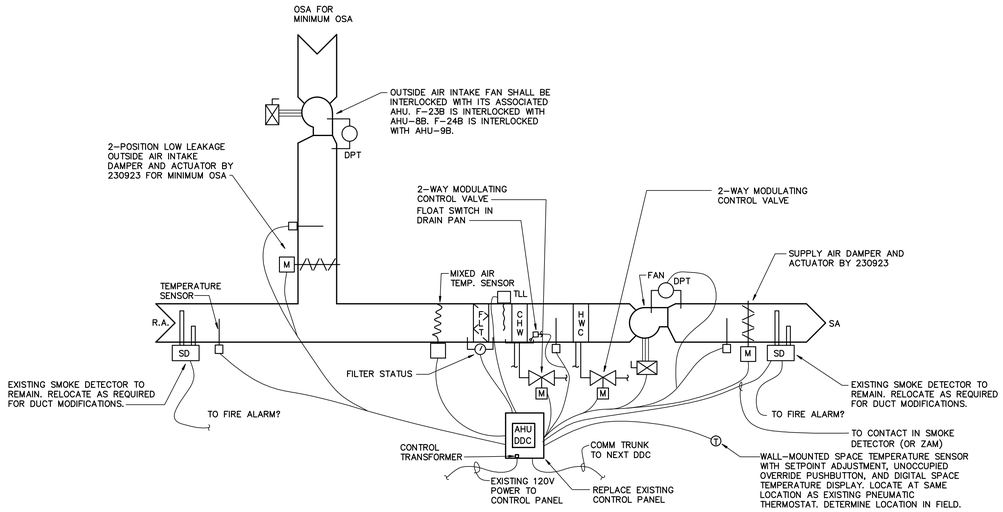

CONSTANT VOLUME AIR HANDLING UNITS AHU-8B AND 9B

APPROXIMATE DUCT MOUNTED DAMPER SIZES FROM 1978 CONTROL DRAWINGS (FIELD VERIFY)
AHU-8B: 12x12 OSA, 24x24 SA, AHU-9B: 12x12 OSA, 24x24 SA,

REVISIONS:

1		
2		
3		
4		
5		

PROJECT #:	24308.00
DATE:	APRIL 10, 2015
DRAWN BY:	JTC
DESIGNER:	JTC
CHECKED BY:	AMS

Pickering
Pickering Firm, Inc.
Facility Design • Civil Engineering • Surveying • Transportation • Natural / Water Resources
6775 Lenox Center Court, Suite 300
Memphis, TN 38115
901.726.0810

OGCB Incorporated
3485 Poplar Avenue, Suite 200
Memphis, TN 38111/901-452-8283
Mechanical/Electrical Consulting Engineers

SBI-000320
HVAC RETROFIT PHASE II
SHELBY COUNTY CRIMINAL JUSTICE CENTER
201 POPLAR AVENUE
MEMPHIS, TENNESSEE 38103

SEAL:



SHEET NUMBER:

M-802

DESCRIPTION:
TEMPERATURE CONTROLS II

4/7/2015 4:18 PM MIKE GUNDY